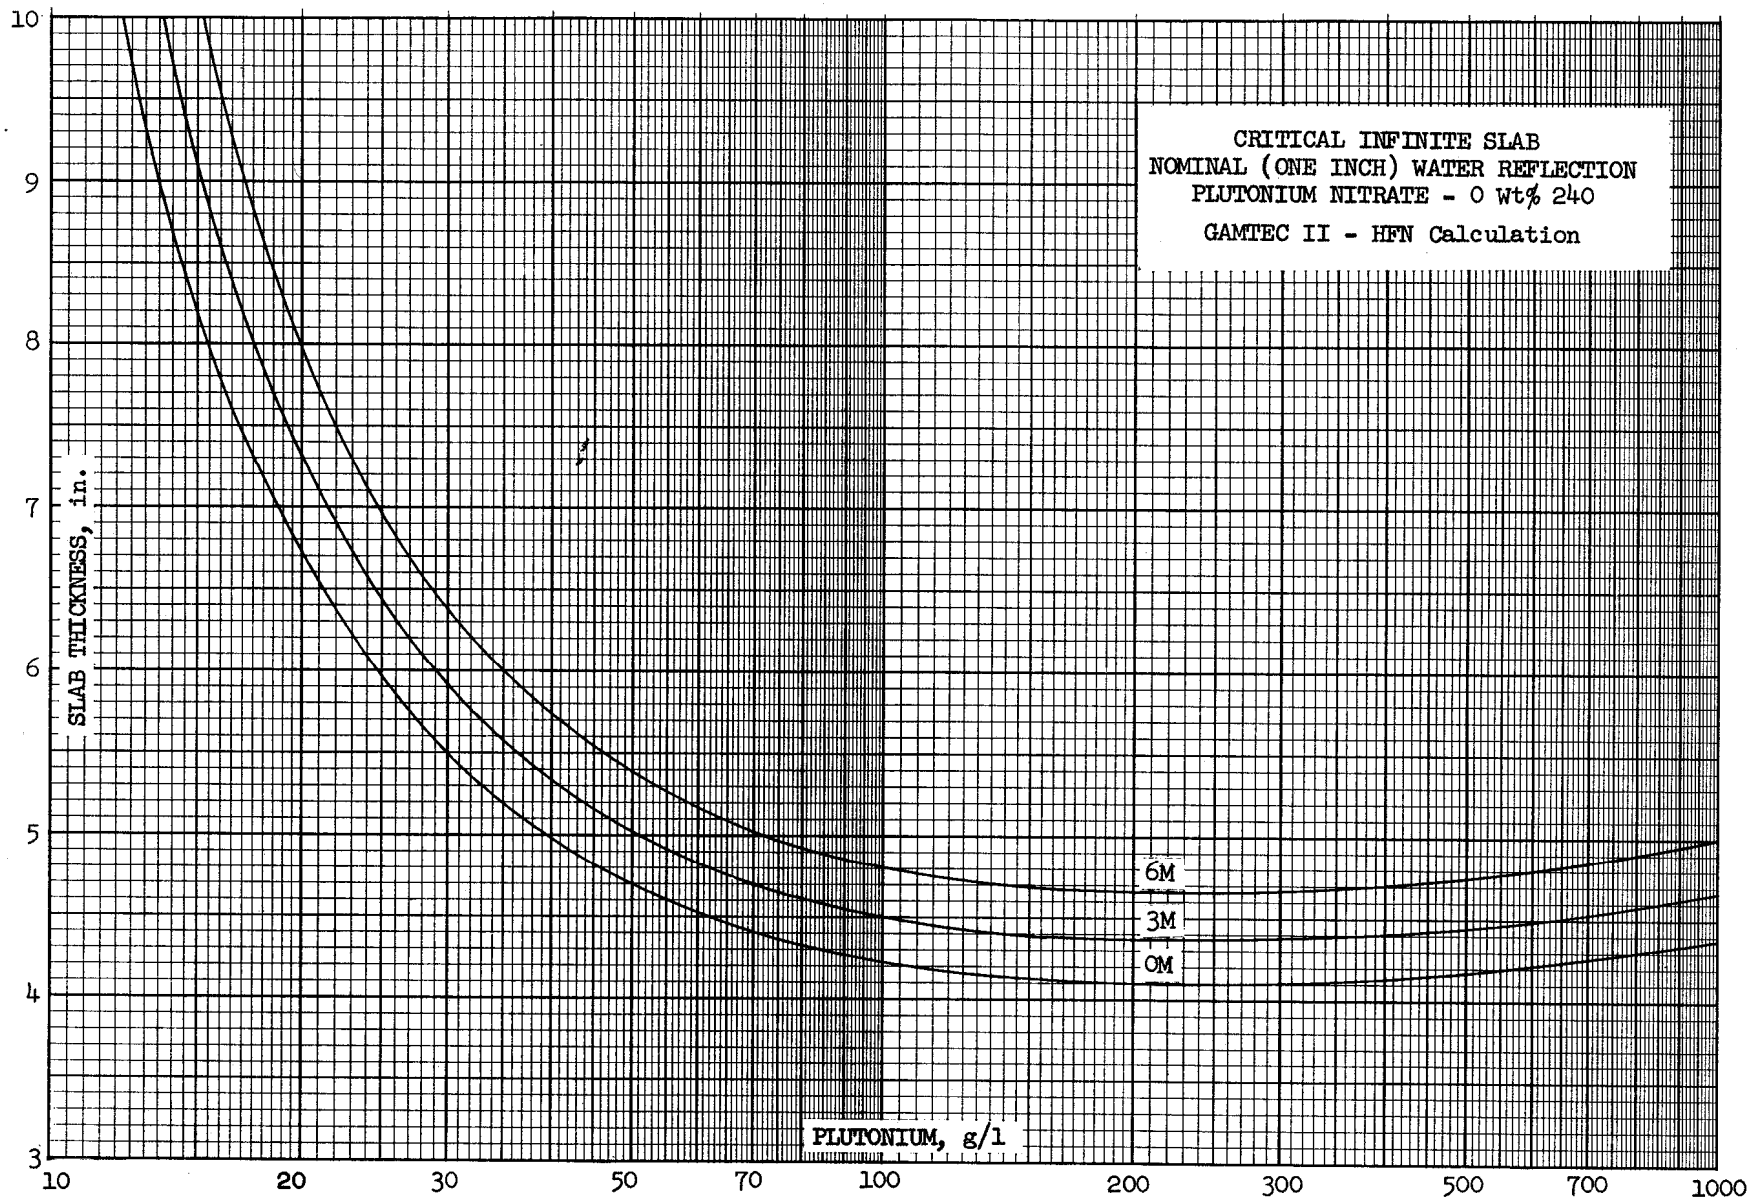
CRITICAL INFINITE SLAB
NOMINAL (ONE INCH) WATER REFLECTION
PLUTONIUM NITRATE - 0 Wt% 240
GAMTEC II - HFN Calculation
SLAB THICKNESS, in.
10
9
8
7
6
5
4
3
PLUTONIUM, g/l
10
20
30
50
70
100
200
300
500
700
1000
6M
3M
0M